


MCT

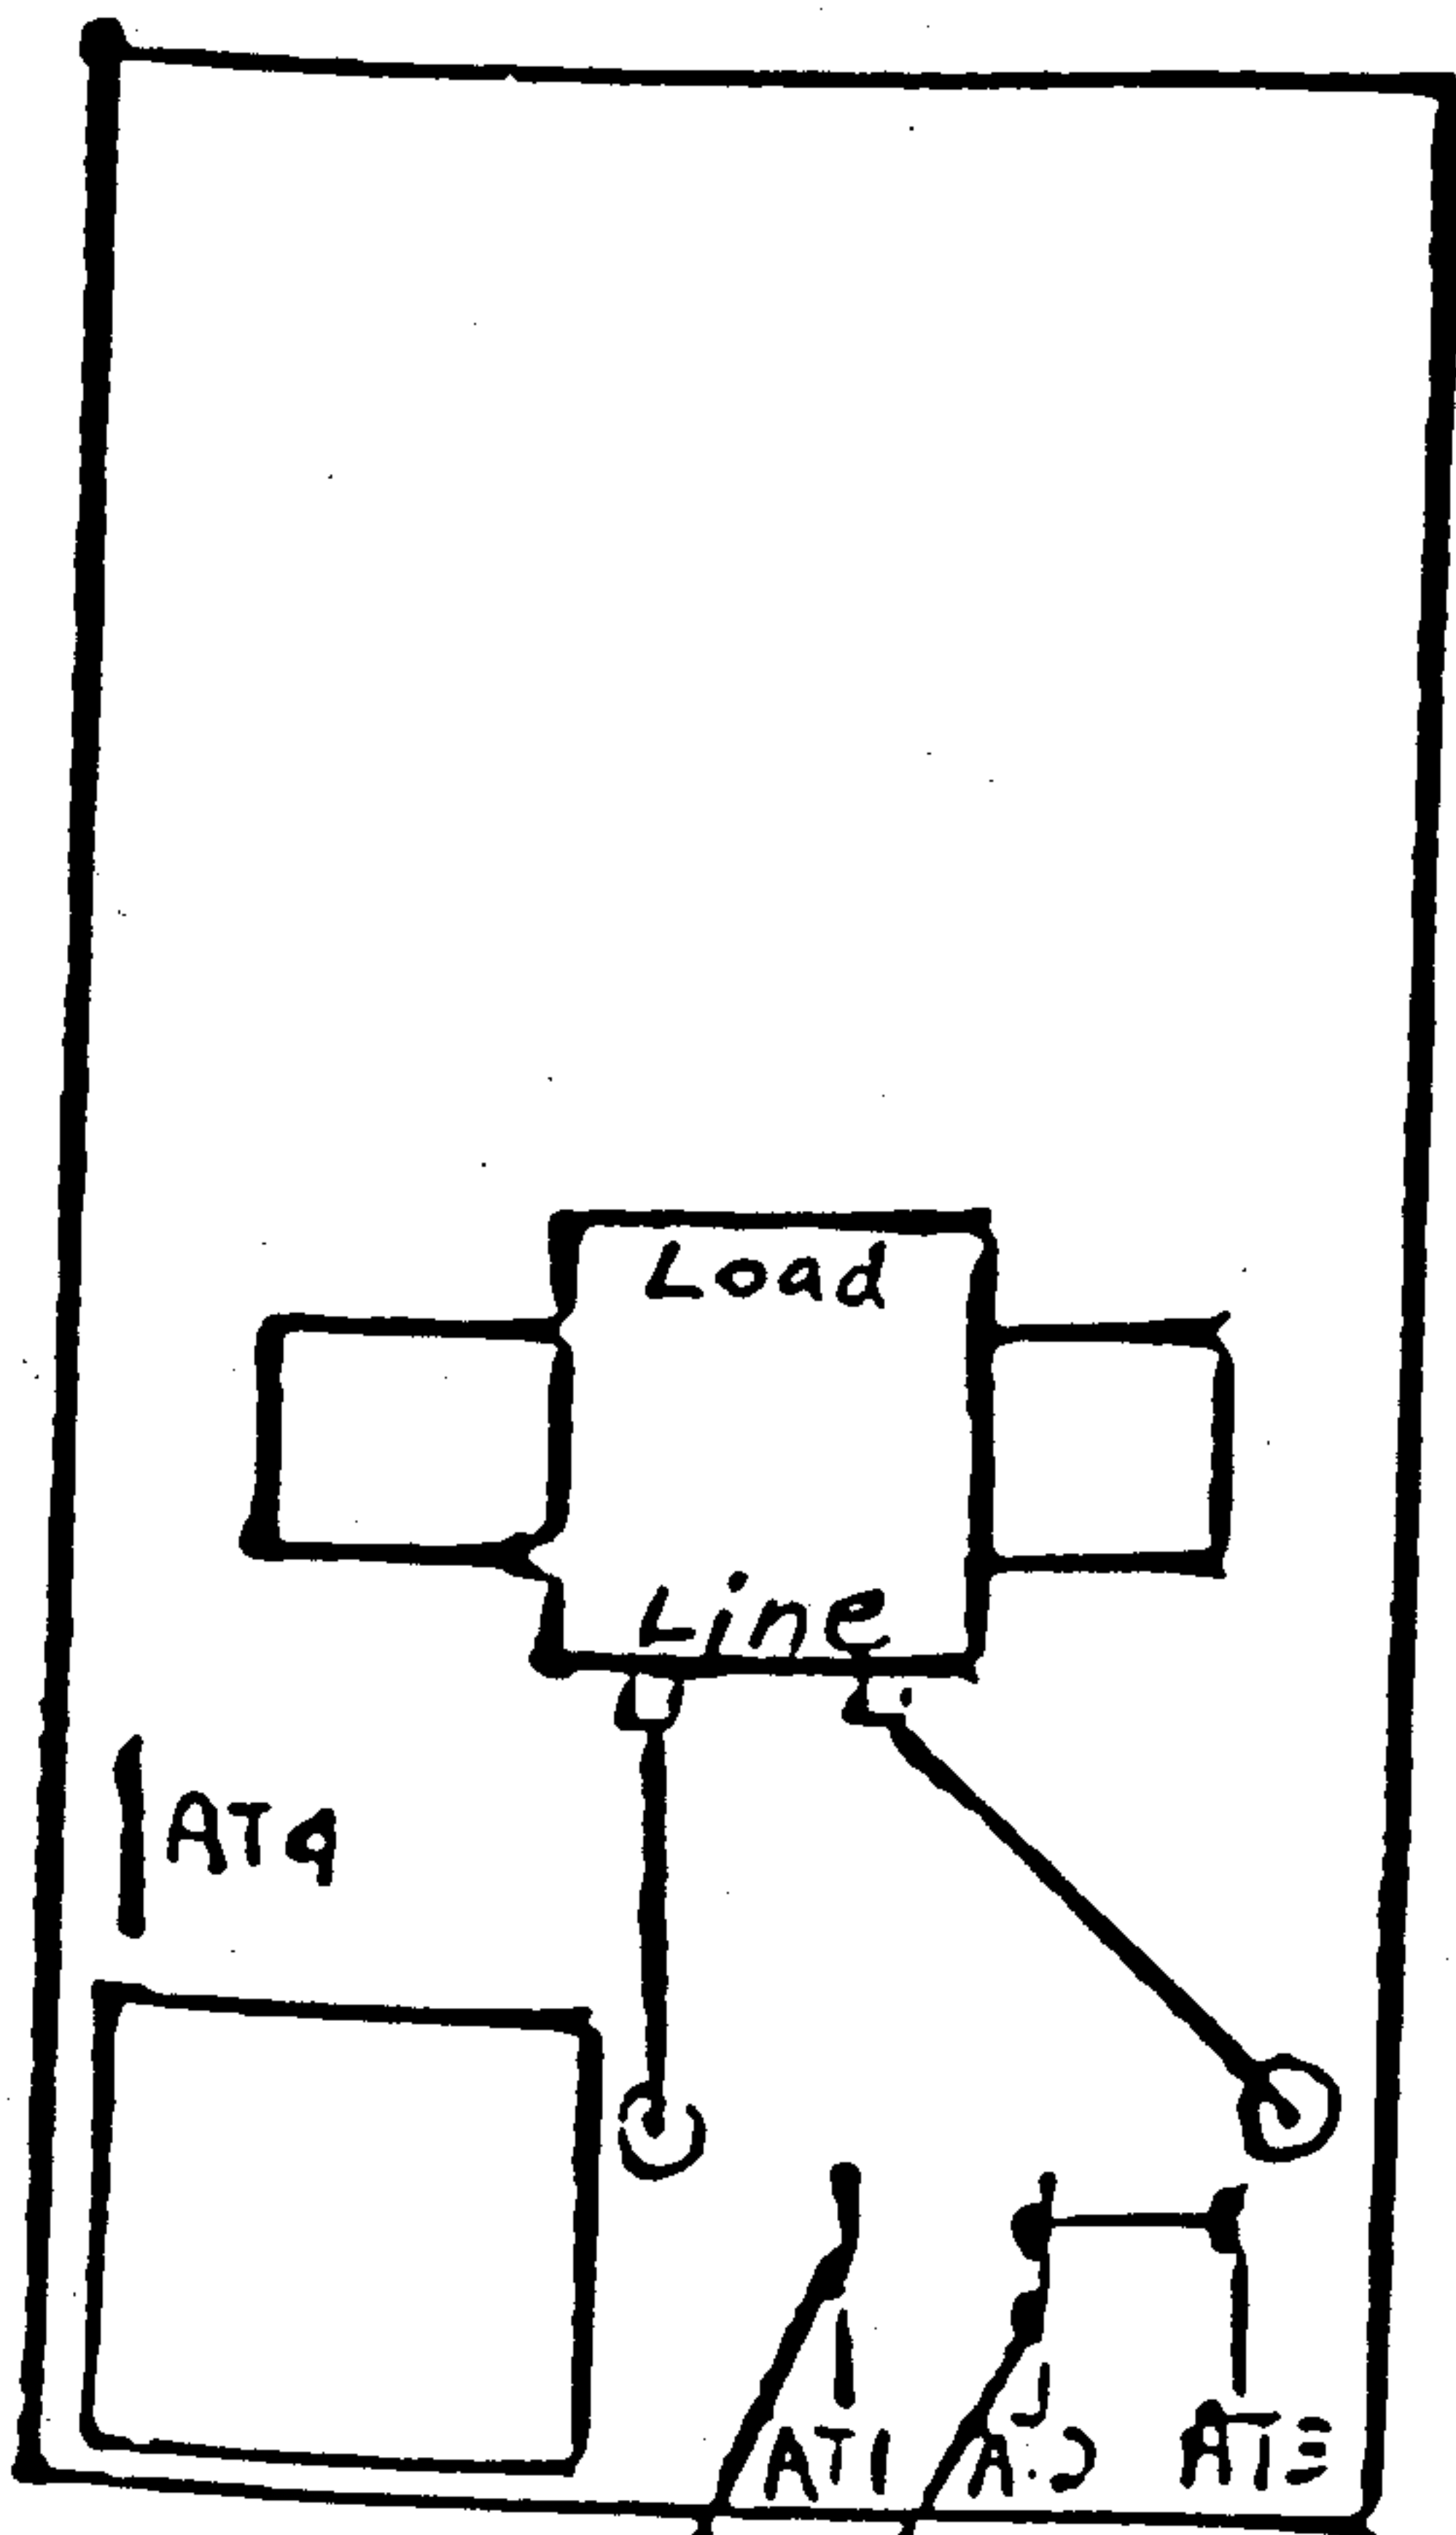

AT2-AT3-Common
AT2 AC Neutral Input
AT1 AC Input

When timer is Engaged
AT-4 becomes Active to
heat up heating element, from
Relay below terminal AT-4

AC Input